


GENERAL NOTES:


1. IF DISTANCE A IS 5' OR LESS, ROTATE MAIN SERVICE TEE AND RECONNECT SERVICE AS PER DETAIL I. IF A IS GREATER THAN 5' INSTALL RISER AS PER DETAIL II.
2. WHERE DEPTH IS INSUFFICIENT TO ALLOW RECONNECTION AS SHOWN IN DETAIL I OR II, RECONNECT SERVICE AS DIRECTED BY ENGINEER.

CONSTRUCTION NOTES:

- A. VARIABLE WITH A MAX. OF 5'.
- B. 1' MIN., 1.5' MAX.
- C. ELBOWS, 45° DEFLECTION MAX.
- D. INSTALL CONCRETE CRADLE ON TEE AS PER DWG. 2135, RIGID PIPE ONLY.
- E. SERVICE TEE.
- F. EXIST. SERVICE LINE.
- G. VARIABLE LENGTH.
- H. BACKFILL UNDER SERVICE WITH MIN. 1 CUBIC FOOT OF P.C. CONCRETE ("SACKCRETE" OR EQUAL ALLOWABLE IN THIS INSTALLATION).

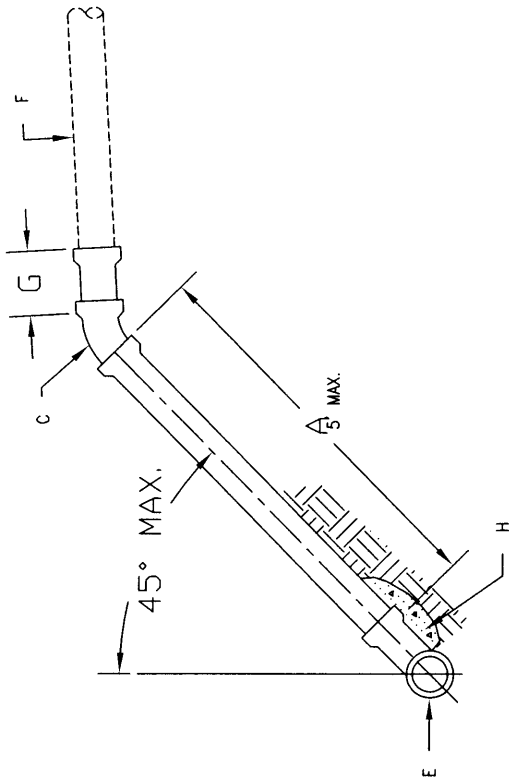

DETAIL I

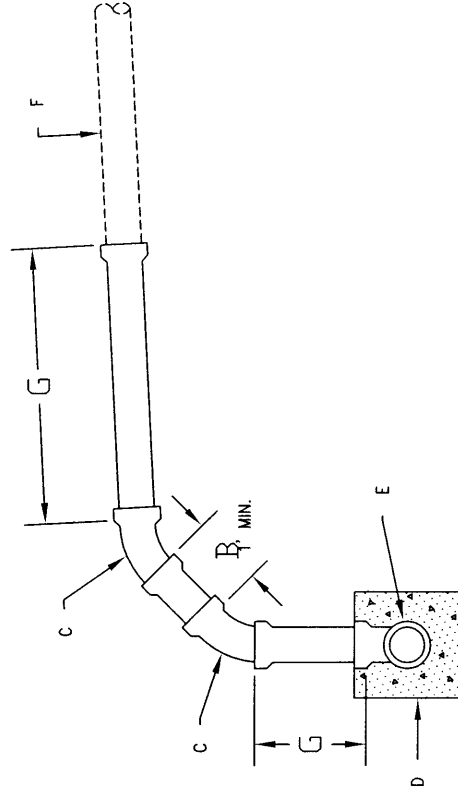

DETAIL II

REVISIONS

NM APWA

SEWER  
SEWER SERVICE  
REPLACEMENT DETAIL

DWG. 2134

FEB. 2006