


GENERAL NOTES:

- UNLESS SHOWN ON CONSTRUCTION DRAWINGS, DIVISION VALVES WILL NOT BE INSTALLED FOR SERVICE CONNECTIONS.

CONSTRUCTION NOTES:

- 45° ELBOW.
- DIVISION VALVE AS SHOWN ON CONSTRUCTION DWGS.
- REDUCTION WYE @ 45°.
- 22 1/2' ELBOW.
- MAIN LINE WYE @ 45°.
- BOTTOM OF BRANCH IS AT TOP OF MAIN.
- BOTTOM OF BRANCH IS 1" - 2" ABOVE TOP OF MAIN.
- VACUUM MAIN
- ELECTRONIC MARKER DISK 12" ABOVE TOP OF PIPE.

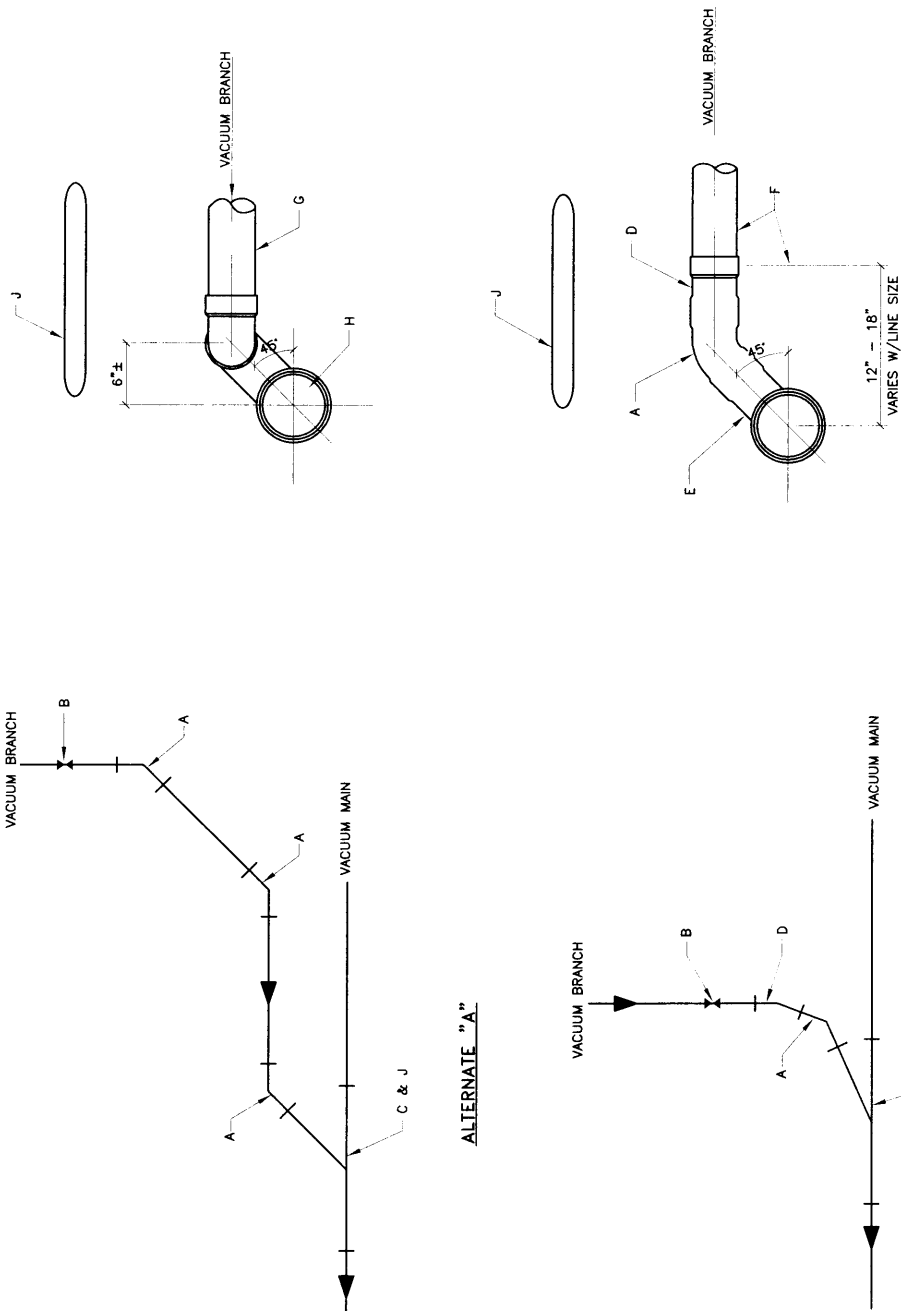

REVISIONS	NM APWA
VACUUM SEWER STANDARDS TYPICAL VACUUM BRANCH LINE CONNECTION	
DWG. 2164 FEB. 2006	