


GENERAL NOTES:

1. ALUMINUM STEP, ALCOA NO. 12653A OR APPROVED EQUAL, STEPS TO BE PLACED AS NOTED ON PLANS.
2. STORM INLETS: INLETS GREATER THAN 4' DEEP SHALL HAVE ALUMINUM STEPS INSTALLED IN UPSTREAM FACE OF INLET WALLS. STEPS SHALL PROTRUDE 7" FROM THE WALL AND BE CENTERED 12" FROM FACE OF CURB. STEPS SHALL BE 12" APART, WITH THE TOP STEP ±18" FROM TOP OF GRATE AND THE BOTTOM STEP NO MORE THAN 16" ABOVE THE CONCRETE FILL IN THE BOTTOM OF THE INLET.
3. DRAINAGE CHANNELS: CHANNELS SHALL HAVE ALUMINUM STEPS FOR ACCESS AND RESCUE INSTALLED PER DETAILS ON DWG. 2261 STEPS SHALL BE INSTALLED ON BOTH SIDES OF THE CHANNEL AND SHALL BE LOCATED IMMEDIATELY BEFORE THE INLET AND AFTER OUTLET TRANSITIONS FOR CROSSING STRUCTURES AND AT 700' MAXIMUM SPACING ALONG CHANNELS.

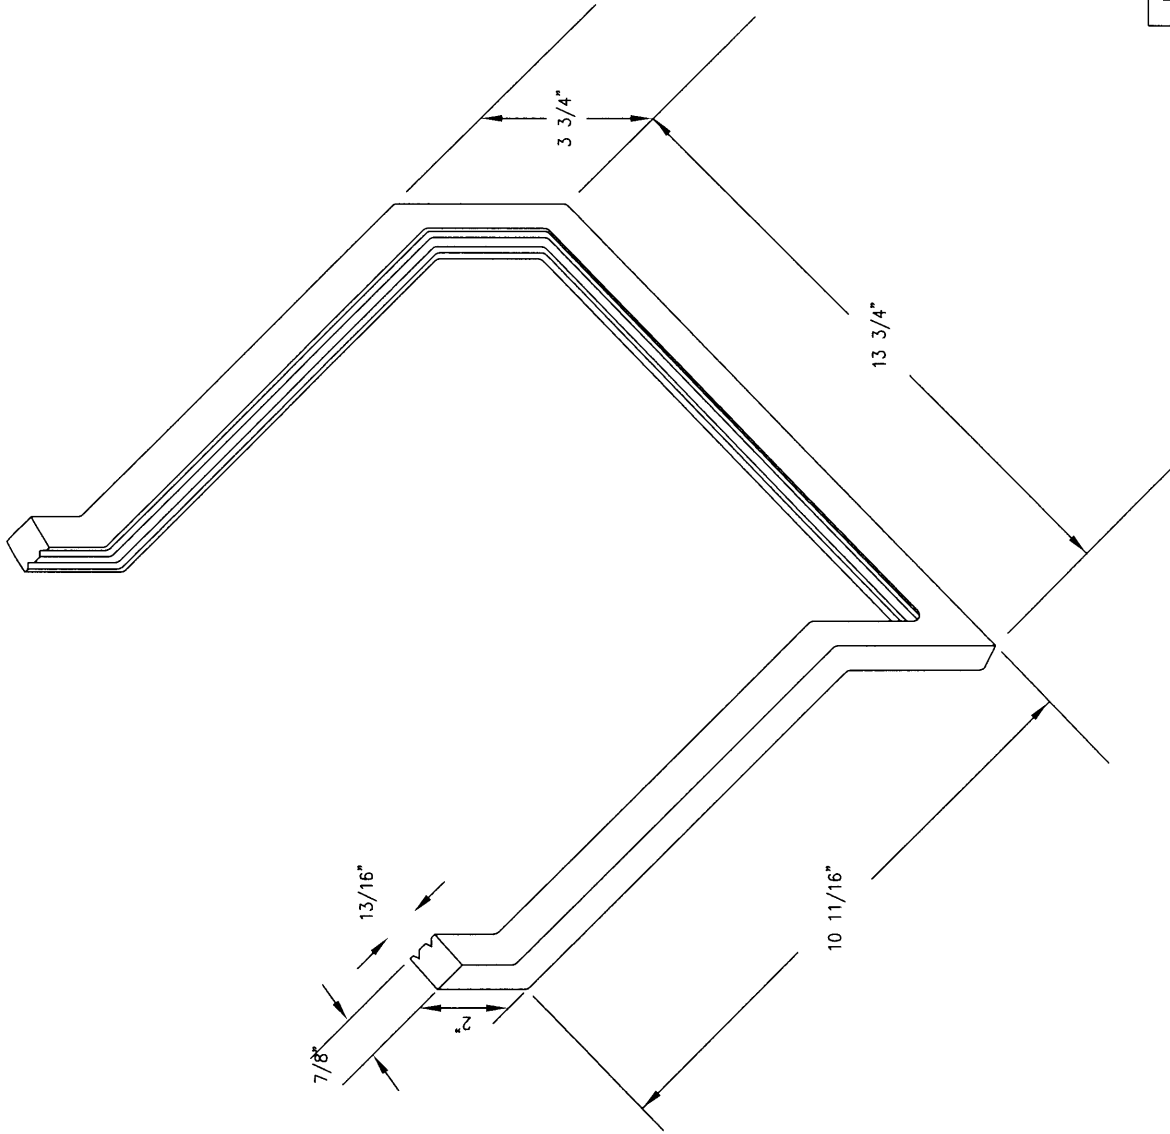

ALUMINUM STEP DETAIL

REVISIONS

NM APWA

DRAINAGE
ALUMINUM STEP DETAIL

DWG. 2229

FEB. 2006